


# **Foot-switch**

Series F2 UN

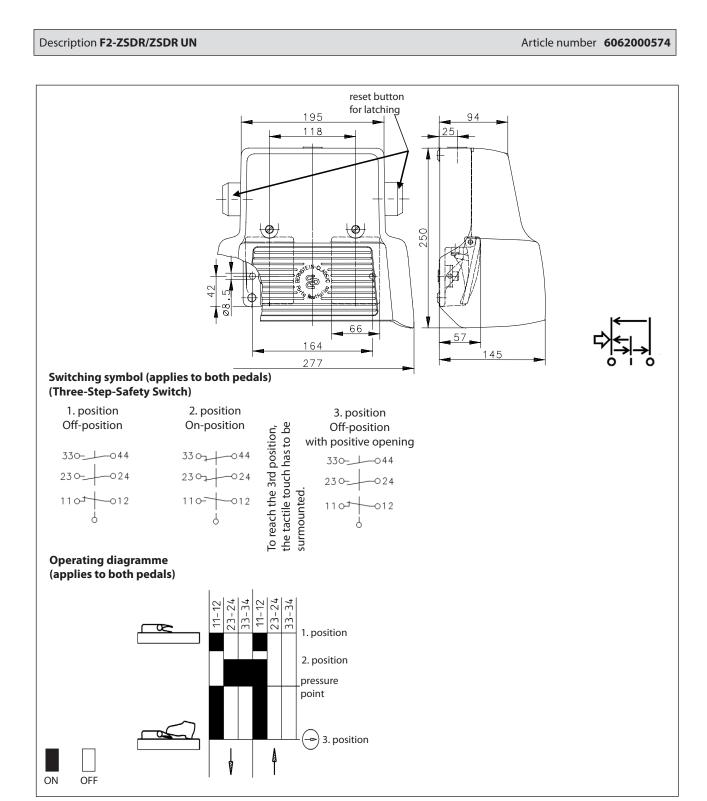

BERNSTEIN AG. Hans-Bernstein-Straße 1.32457 Porta Westfalica. www.bernstein.eu

# **Technical Data**



Electrical Data		
Rated insulation voltage	U <sub>i</sub>	250 V
Conv. thermal current	l <sub>the</sub>	5 A
Rated impulse withstand voltage	$U_{imp}$	2,5 KV
Rated operational voltage	U <sub>e</sub>	240 V AC and 24 V DC
Utilization category		AC-15, U <sub>e</sub> /I <sub>e</sub> 240 V AC / 1,5 A 50-60 Hz DC-13, U <sub>e</sub> /I <sub>e</sub> 24 V DC/ 1,0 A
Direct opening action	$\odot$	acc. to IEC/EN 60947-5-1, annex K
Short-circuit protective device		D-Fuse 4 A gG
Protection class		I

Mechanical data	
Enclosure	AL, die-cast
Protective guard (Accident protection cover UN)	AL, die-cast
Actuator	Foot lever (PA)
Ambient air temperature	Operating temperature range: -10 °C to +50 °C Storage temperature range: -25 °C to +70 °C
Contact type (each pedal)	1 NC, 2 NO. (Zb)
Operating force (pedal centre) (each pedal) 1. position 2. position	
Pressure point (each pedal)	≈ 200 N
Mechanical life (each pedal) Sequence of the switching position: 1 – 2 – 1 or: 1 – 2 – 3 – 1	10 x 10 <sup>6</sup> operating cycles 1 x 10 <sup>6</sup> operating cycles
Switching frequency	max. 50/min
Assembly	2 x M8
Connection	screw connections (M3,5)
Protection ground	2 x M4
Conductor cross-sections	Solid: 0,5 1,5 mm <sup>2</sup> Litz wire with ferrules: 0,5 1,5 mm <sup>2</sup>
Cable entrance	1 x M20 x 1,5
Weight	≈ 2,3 kg
Protection type	IP67 in accordance with IEC/EN 60529

ID for safety engineering	
B10d	
Sequence of the switching position: $1-2-1$ $10 \times 10^6$ cycles	
or: 1–2–3–1 1 x 10 <sup>6</sup> cycles	

Regulations	
	VDE 0660 T100, DIN EN 60947-1, IEC 60947-1
	VDE 0660 T200, DIN EN 60947-5-1, IEC 60947-5-1
	DIN EN 61326-3-1
	DIN EN ISO 13849-1

EU Conformity		
	acc. to directive 2014/35/EU (Low-Voltage-Directive)	

BERNSTEIN AG. Hans-Bernstein-Straße 1.32457 Porta Westfalica. www.bernstein.eu

## **Technical Data**



## **Approvals**

 $_{c}UL_{us}$ 

### **Function**

Normally open contacts: 23 – 24, 33 – 44; Signalling contact: 11 – 12

- Position 1: OFF position of the operating contacts (the pedal is not actuated)
- Position 2: ON position of the operating contacts (the pedal is actuated to as far as the pressure point)
- Position 3: OFF position of the operating contacts (the pedal is fully actuated)

If the three-stage enable switch is actuated in position 2, it returns to position 1 when it is released. The three-stage enable switch changes from position 2 to position 3, if it gets further pressed unter after the resistance of the pressure point.

The actuation of the operating contacts is made by a positive opening.

Once the pedal is not pressed, the three-stage enable switch returns to position 1.

The operating contacts are opened in the return stroke.

### Notes

The specified protection classification (IP code) applies only when the cover is closed and the appropriate cable is used, in accordance with the clamping range of the above mentioned cable gland.